

NOTES

Schedule 80 PVC on all elbows and conduit above ground; schedule 40 otherwise.

All conduit depths will be based on final grade. Final conduit will be inspected by Nolin's Service department before backfilling.

- DIAGRAM NOT TO SCALE
- CONTACT NOLIN RECC LINE DESIGN DEPARTMENT BEFORE STARTING ANY WORK
- CALL 811 BEFORE DIGGING



A Touchstone Energy® Cooperative

MAIN OFFICE: 270-765-6153


DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE


**SINGLE PHASE PRIMARY
TRANSFORMER
INSTALLATION**

LAST REVISION

5/30/2018

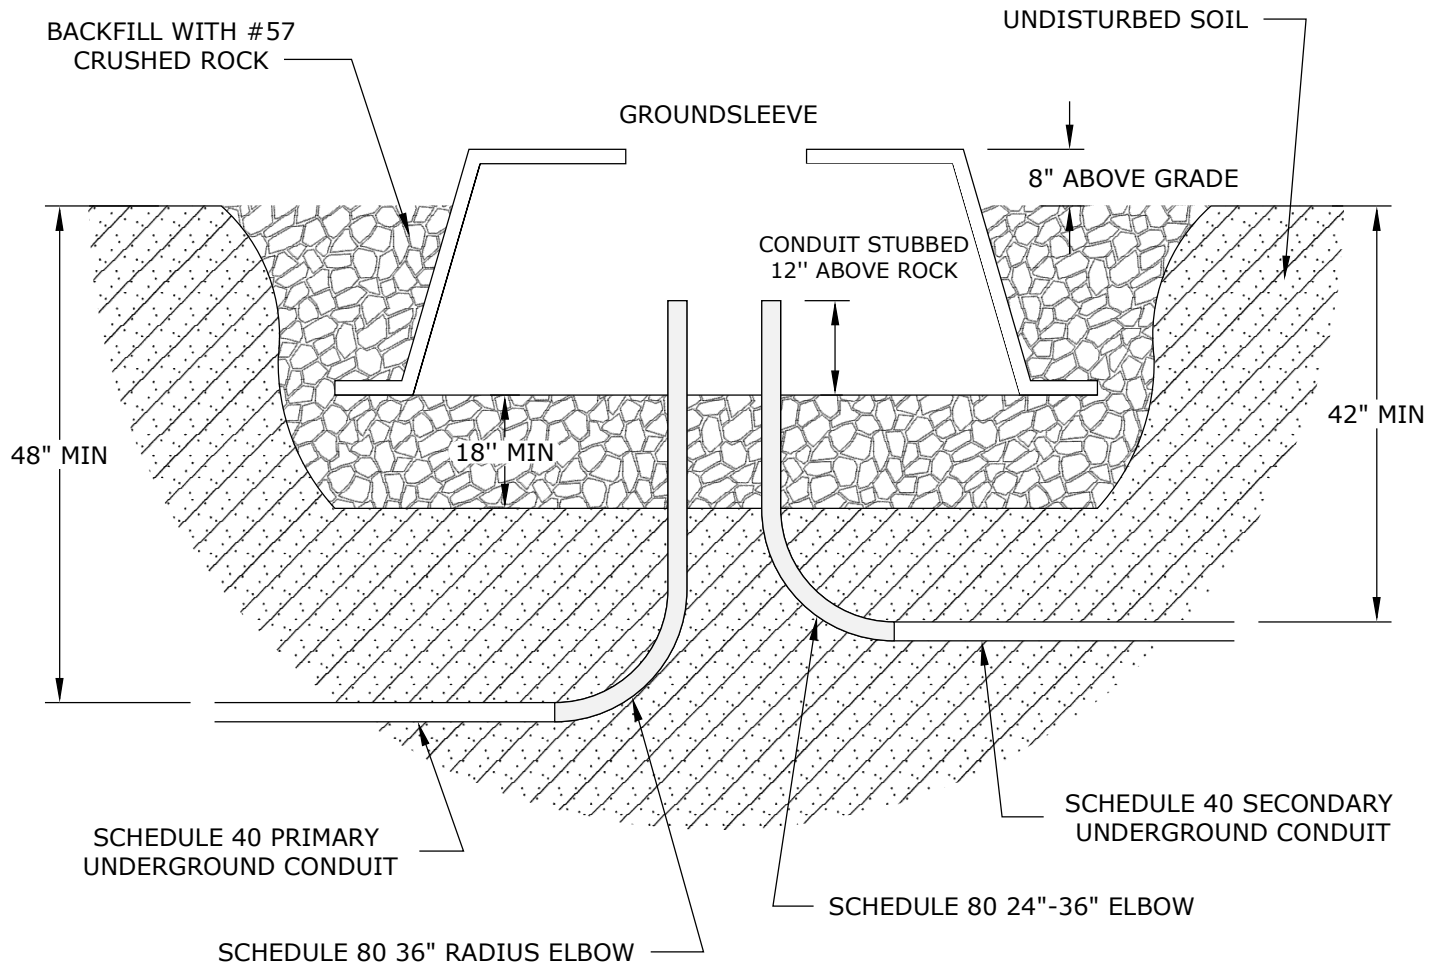

TOP VIEW

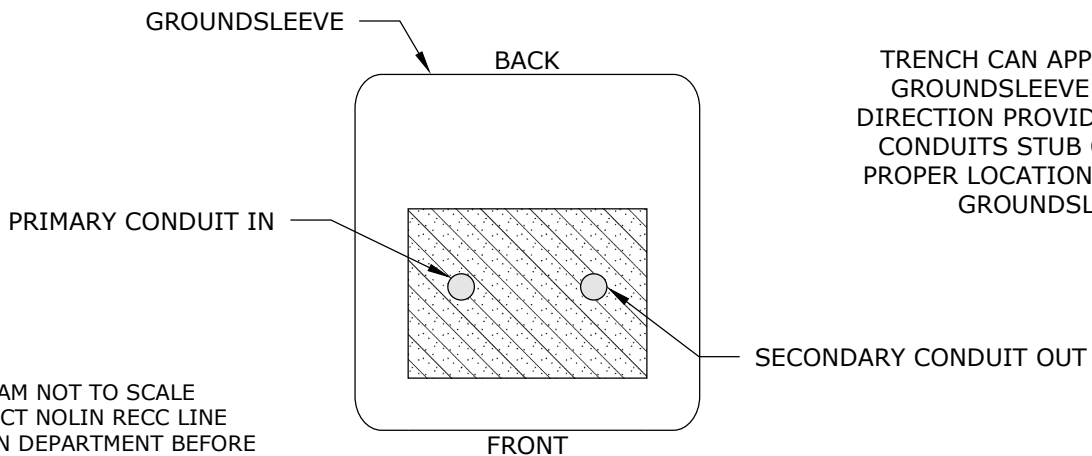

TRENCH CAN APPROACH THE GROUNDSLEEVE FROM ANY DIRECTION PROVIDED THAT THE CONDUITS STUB OUT AT THE PROPER LOCATION WITHIN THE GROUNDSLEEVE.

- DIAGRAM NOT TO SCALE
- CONTACT NOLIN RECC LINE DESIGN DEPARTMENT BEFORE STARTING ANY WORK
- CALL 811 BEFORE DIGGING



A Touchstone Energy® Cooperative

MAIN OFFICE: 270-765-6153

DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE

**SINGLE PHASE PRIMARY
TRANSFORMER
INSTALLATION**


LAST REVISION

5/30/2018

NOTES

1. All transformer locations must be approved by Nolin’s Line Design Department prior to service installation.
2. All electric connections, equipment, and equipment grounds shall comply with the National Electrical Code.
3. The member shall furnish and maintain for the life of the electrical service all conduits, conduit straps, grounds, disconnects, meter base, and all conductors beyond Nolin’s point of delivery.
 - In three phase applications, Nolin shall furnish the meter base.
4. Nolin shall furnish and maintain the meter.
5. Energizing of the member’s service is contingent upon an approved State or City electrical inspection.
6. All underground conduit must have pull string installed (150 lbs test min).



A Touchstone Energy® Cooperative 

MAIN OFFICE: 270-765-6153

DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE

**SINGLE PHASE PRIMARY
TRANSFORMER
INSTALLATION**

LAST REVISION

5/30/2018