

A Touchstone Energy® Cooperative

MAIN OFFICE: 270-765-6153

DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE


**OVERHEAD SERVICE
ATTACHMENT**

LAST REVISION

5/30/2018

SERVICE ENTRANCE CLEARANCES


TOP VIEW OF HOME/BUILDING

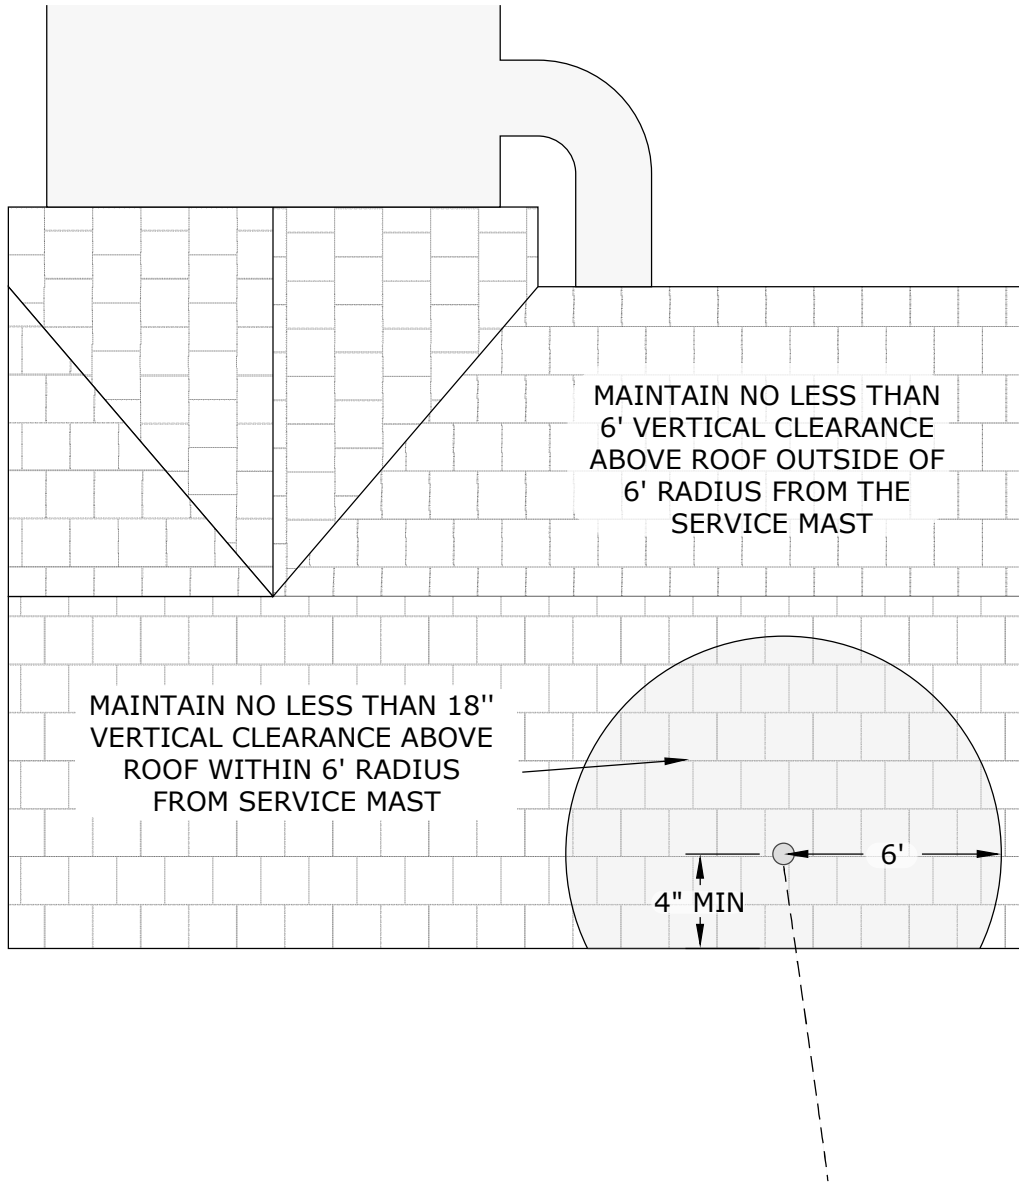

- DIAGRAM NOT TO SCALE
- CONTACT NOLIN RECC LINE DESIGN DEPARTMENT BEFORE STARTING ANY WORK
- CALL 811 BEFORE DIGGING

PAGE 2 OF 3



A Touchstone Energy® Cooperative 

MAIN OFFICE: 270-765-6153

DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE

**OVERHEAD SERVICE
ATTACHMENT**


LAST REVISION

5/30/2018

NOTES

1. All new or upgraded commercial, industrial, farm and residential services shall be installed underground. Special permission must be given by Nolin's Line Design Department to install overhead electrical service.
2. Nolin will furnish the meter, service drop conductor, and service attachment to the conduit mast. The Cooperative will connect the member's conductors to the Cooperative's service drop.
3. The Member will furnish the service entrance conduit, conductor, and meter base in accordance to code requirements. Do not use a small meter base. A minimum of 18" of the member's conductor must extend from the weatherhead.
4. A strong service mast must be mounted on the side nearest Nolin's distribution pole. A clear path must exist between the service drop attachment and the pole. Avoid service wire overhang above roof, or provide code clearance.
5. Energizing of the member's service is contingent upon a State or City electrical inspection.
6. See page 2 for clearance requirements.



A Touchstone Energy® Cooperative 

MAIN OFFICE: 270-765-6153

DRAWN BY:
LANDER RYAN

APPROVED BY:
GREG LEE

**OVERHEAD SERVICE
ATTACHMENT**

LAST REVISION

5/30/2018